

Particle swarm optimisation technique to improve energy efficiency of doubly-fed induction generators for wind turbines

Sompracha, Chergchai; Jayaweera, Dilan; Tricoli, Pietro

DOI:

[10.1049/joe.2018.9348](https://doi.org/10.1049/joe.2018.9348)

License:

Creative Commons: Attribution (CC BY)

Document Version

Publisher's PDF, also known as Version of record

Citation for published version (Harvard):

Sompracha, C, Jayaweera, D & Tricoli, P 2019, 'Particle swarm optimisation technique to improve energy efficiency of doubly-fed induction generators for wind turbines', *The Journal of Engineering*.
<https://doi.org/10.1049/joe.2018.9348>

[Link to publication on Research at Birmingham portal](#)

Publisher Rights Statement:

Checked for eligibility: 17/07/2019

General rights

Unless a licence is specified above, all rights (including copyright and moral rights) in this document are retained by the authors and/or the copyright holders. The express permission of the copyright holder must be obtained for any use of this material other than for purposes permitted by law.

- Users may freely distribute the URL that is used to identify this publication.
- Users may download and/or print one copy of the publication from the University of Birmingham research portal for the purpose of private study or non-commercial research.
- User may use extracts from the document in line with the concept of 'fair dealing' under the Copyright, Designs and Patents Act 1988 (?)
- Users may not further distribute the material nor use it for the purposes of commercial gain.

Where a licence is displayed above, please note the terms and conditions of the licence govern your use of this document.

When citing, please reference the published version.

Take down policy

While the University of Birmingham exercises care and attention in making items available there are rare occasions when an item has been uploaded in error or has been deemed to be commercially or otherwise sensitive.

If you believe that this is the case for this document, please contact UBIRA@lists.bham.ac.uk providing details and we will remove access to the work immediately and investigate.

Particle swarm optimisation technique to improve energy efficiency of doubly-fed induction generators for wind turbines

Cherngchai Sompracha¹ ✉, Dilan Jayaweera¹, Pietro Tricoli¹¹Department of Electronic, Electrical and Systems Engineering, University of Birmingham, Birmingham, UK

✉ E-mail: CXS407@student.bham.ac.uk

eISSN 2051-3305

Received on 5th November 2018

Accepted on 10th January 2019

doi: 10.1049/joe.2018.9348

www.ietdl.org

Abstract: Wind energy conversion systems (WECSs) require a suitable control to maximise the power generated by wind turbines independently on the wind conditions. Variable-speed fixed-pitch wind turbines with doubly-fed induction generators (DFIG) are used in WECSs for their higher reliability and efficiency compared to variable-pitch wind turbine systems. This study proposes an effective control algorithm to maximise the efficiency of fixed-pitch wind turbines with DFIGs using particle swarm optimisation control to compensate for the errors in the estimation of the circuit parameters of the generator. The proposed control algorithm generates an optimal speed reference to optimise the mechanical power extracted from the wind and the optimal d -axis rotor current through stator reactive power management to minimise the electrical losses of the doubly-fed generator. The optimal speed reference is provided by a maximum power point tracking control below the rated wind speed and a soft-stalling control above the rated wind speed, while the optimal d -axis rotor current is searched by a particle swarm optimisation algorithm. The proposed control system has been verified by numerical simulations and it has been demonstrated that the energy generated for typical wind speed profiles is greater than that of a traditional control based on a model-based loss minimisation.

Nomenclature

u_{sd}, u_{sq}	stator voltage components in dq reference frame
u_{rd}, u_{rq}	rotor voltage components in dq reference frame
i_{sd}, i_{sq}	stator current components in dq reference frame
i_{rd}, i_{rq}	rotor current components in dq reference frame
ψ_{sd}, ψ_{sq}	stator flux linkage components in dq reference frame
ψ_{rd}, ψ_{rq}	rotor flux linkage components in dq reference frame
ω_m	mechanical angular speed
ω_r	electrical angular speed of rotor
ω_s	dq reference frame (stator flux) angular speed
θ_r	rotor vector position
θ_s	dq reference frame (stator flux) vector position
r_s, r_r	stator, rotor resistances per phase
L_s, L_r, L_m	stator, rotor, mutual inductances per phase
P_s, Q_s	stator active and reactive powers
T_{em}, T_L	electromagnetic and load torques
P_m	mechanical power from a wind turbine
P_e	electrical power from DFIG
ρ	air density
V_w	wind speed
ω_t	turbine angular speed

1 Introduction

Wind energy is one of the most attractive renewable energy for its large availability and high power density [1]. A wind energy conversion system (WECS) converts the kinetic energy of wind into electrical energy with a wind turbine, an electrical generator and a controller. A gearbox and a converter are optional parts that depend on the type of generator and controller in the WECS.

The efficiency of WECSs has become an interesting research topic over the recent years for the significant potential of reducing of the need for fossil fuels for power generation [2]. Variable-speed wind turbines (VSWTs) have been developed to improve the amount of power extracted from wind for all wind speeds and, hence, they are more efficient than fixed-speed wind turbines (FSWTs) [3, 4]. In a VSWT system, a doubly-fed induction

generator (DFIG) is used to convert mechanical power into electrical power as they require only a small power converter in comparison to a permanent magnet synchronous generator.

The optimal mechanical power that can be extracted from a wind turbine is shown in Fig. 1 as a function of the wind speed [5]. In regions 1 and 4, the wind turbine must be halted because the power from the wind turbine is either not enough to sustain a continuous generation or is dangerous for the blades. In region 2, i.e. from cut-in speed, v_{cut-in} , to rated wind speed, v_{rated} , VSWT is controlled with a maximum power point tracking (MPPT) controller. Well-known MPPT methods have been reported in the literature, such as the optimal tip-speed ratio (TSR) control [6], the power signal feedback (PSF) control [7], and the perturb and observe (P&O) control [8]. Above the rated speed and up to the cut-out speed, $v_{cut-out}$, the power is limited by either a passive stall control or an active stall with speed control [9] and pitch control [2].

As reported in the literature, pitch control is expensive and has a high maintenance cost [10]. To improve the dynamic efficiency, it is preferable to use a fixed-pitch wind turbine with an active stall control, also known as soft-stalling control, obtained with the speed control of the generator [9, 11, 12]. However, there is still not a clear understanding of the control of fixed-pitch wind turbines for the entire wind speed range indicated in Fig. 1.

MPPT and minimum electric loss (MEL) controllers have been proposed to optimise the efficiency of the wind turbine when the electrical generator is a squirrel-cage induction generator [13]. This control can be extended to DFIGs, with the advantage of independent control of the shaft speed/torque and stator reactive power when a stator field oriented (SFO) vector control of the rotor converter is used [14]. When a DFIG is used as a generator, the efficiency of the WECS can be also improved with optimal control of the reactive power. Several methods have been proposed to derive the optimal control law of DFIGs, e.g. using a copper loss model [15], an iron and copper loss model [16], and a loss model of the generator, the filter and the power converter [17]. However, all these loss minimisation controllers require the accurate knowledge of the parameters of the DFIG, the filter and the power converter for generating the optimal control law. In practical applications, these parameters are only roughly known and some of

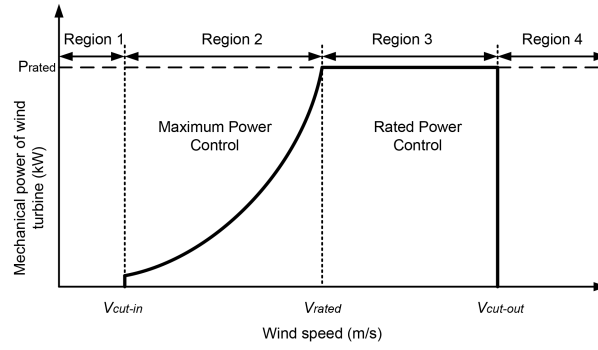


Fig. 1 Mechanical power captured from wind turbine [5]

them, like the rotor resistance, are sensibly dependent on the temperature [18]. This problem leads to the inaccurate determination of the condition of minimum losses, reducing the efficacy of the algorithms.

Searching methods have been used to overcome the limitations of model-based loss minimisation control (MBLC). Several search techniques have been reported in the literature, such as P&O, genetic algorithm and particle swarm optimisation (PSO) [19]. In this paper, a PSO control is used to maximise the electrical power of DFIG under uncertainty conditions of the DFIG parameters. PSO is one of the most efficient meta-heuristics conceptualised from the pattern movement of a flock of the bird looking for food to solve the optimisation problem [19]. As population-based search algorithm properties, PSO gives the high performance to avoid trapping in its local solution of multi-peak functions.

Therefore, this paper proposes a new optimal control that uses MPPT and a soft-stalling controller to obtain the optimal speed reference for the electrical generator and a PSO searching control to obtain the optimal i_{rd} reference for the SFO vector control.

2 System modelling and description of the control

2.1 Wind turbine modelling

The mechanical power extracted from a wind turbine is given by the following expression [14]:

$$P_m = \frac{1}{2} \rho \pi R^2 V_w^3 C_p(\lambda, \beta) \quad (1)$$

The power coefficient of the wind turbine, C_p , is a function of the TSR, λ , and the pitch angle, β , and is defined by manufacturer design. In this paper, the power coefficient is given by the approximate formula suggested in [14]

$$C_p(\lambda, \beta) = 0.5176 \left(\frac{116}{\lambda_i} - 0.4\beta - 5 \right) e^{-(21/\lambda_i)} + 0.0068\lambda \quad (2)$$

where

$$\frac{1}{\lambda_j} = \frac{1}{\lambda + 0.08\beta} - \frac{0.035}{1 + \beta^3} \quad (3)$$

The TSR can be calculated as

$$\lambda = \frac{\omega_t R}{V_w} \quad (4)$$

2.2 DFIG modelling

The three-phase dynamic model of the DFIG in the d - q reference frame can be expressed by the following equations [14]:

$$\begin{cases} u_{sd} = r_s i_{sd} + \frac{d\psi_{sd}}{dt} - \omega_s \psi_{sq} \\ u_{sq} = r_s i_{sq} + \frac{d\psi_{sq}}{dt} + \omega_s \psi_{sd} \\ u_{rd} = r_r i_{rd} + \frac{d\psi_{rd}}{dt} - (\omega_s - n_p \omega_m) \psi_{rq} \\ u_{rq} = r_r i_{rq} + \frac{d\psi_{rq}}{dt} + (\omega_s - n_p \omega_m) \psi_{rd} \\ J = \frac{d\omega_m}{dt} = T_{em} - T_L \end{cases} \quad (5)$$

Under the assumption of negligible iron loss and an unsaturated main magnetic circuit, the flux linkage equations, are

$$\begin{cases} \psi_{sd} = L_s i_{sd} + L_m i_{rd} \\ \psi_{sq} = L_s i_{sq} + L_m i_{rq} \\ \psi_{rd} = L_s i_{sd} + L_r i_{rd} \\ \psi_{rq} = L_m i_{sq} + L_r i_{rq} \end{cases} \quad (6)$$

in which

$$\begin{cases} L_s = L_{ls} + L_m \\ L_r = L_{lr} + L_m \end{cases} \quad (7)$$

The equation of the electromagnetic torque is

$$T_{em} = \frac{3}{2} n_p \frac{L_m}{L_s} (\psi_{sq} i_{rd} - \psi_{sd} i_{rq}) \quad (8)$$

The stator active and reactive powers are

$$\begin{cases} P_s = \frac{3}{2} (u_{sq} i_{sq} + u_{sd} i_{sd}) \\ Q_s = \frac{3}{2} (u_{sq} i_{sd} - u_{sd} i_{sq}) \end{cases} \quad (9)$$

2.3 Field-oriented control of rotor side converter (RSC)

In the stator flux-oriented control, the d -axis of d - q reference frame is oriented with the stator-flux vector. Therefore, the dq components of stator flux linkage are

$$\begin{cases} \psi_{sd} = |\psi| \\ \psi_{sq} = 0 \end{cases} \quad (10)$$

Assuming the stator flux linkage constant and neglecting the stator resistance, the stator voltage (5) are simplified as

$$\begin{cases} u_{sd} = 0 \\ u_{sd} = \omega_s \psi_{sd} \end{cases} \quad (11)$$

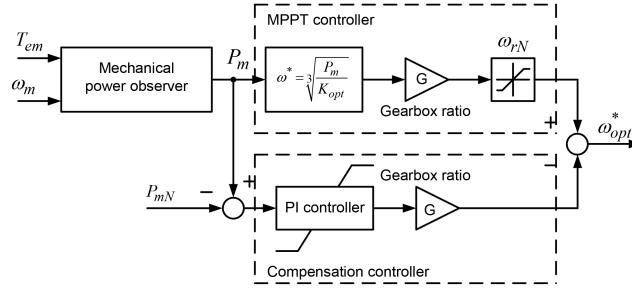


Fig. 2 Block diagram of PSF-MPPT and soft-stalling control

Combining (6) and (10), the mechanical equation can be expressed as follows:

$$J \frac{d\omega_m}{dt} = -\frac{3}{2} n_p \frac{L_m}{L_s} \psi_{sd} i_{rq} - T_L \quad (12)$$

and the active and the reactive powers are

$$\begin{cases} P_s = -\frac{3}{2} \frac{L_m}{L_s} u_{sq} i_{rq} \\ Q_s = \frac{3}{2} \frac{\psi_{sd}}{L_s} u_{sq} - \frac{3}{2} \frac{L_m}{L_s} u_{sq} i_{rq} \end{cases} \quad (13)$$

Equations (12) and (13) point out that the electromagnetic torque and the stator active power are controlled only by i_{rq} , while the stator reactive power is controlled only by i_{rd} . Therefore, the control of shaft speed and stator reactive power of the outer control loop can be decoupled by controlling independently i_{rd} and i_{rq} .

3 Optimised control of DFIG for fixed-pitch wind turbines

3.1 MPPT controller

To track maximum power from a wind turbine, the MPPT controller is used to keeping coefficient power, C_p , at its maximum value, C_{pmax} , when wind speed is below the rated value. From (1), the maximum mechanical power as a function of the turbine shaft speed is

$$P_{m,opt} = \frac{1}{2} \rho \pi R^5 \frac{C_{pmax}}{\lambda_{opt}^3} \omega_t^3 = K_{opt} \omega_t^3 \quad (14)$$

This paper uses an MPPT algorithm based on PSF for the fast-tracking characteristics and simplicity, as it does not need speed sensors. The mechanical power is derived by an observer and, hence, the optimal speed reference is calculated from the following equation:

$$\omega_{opt}^* = \sqrt[3]{\frac{P_m}{K_{opt}}} \quad (15)$$

3.2 Soft-stalling controller

When the wind speed is higher than the rated value, soft-stalling control is used to limit the power of the turbine to the rated value, P_{mN} , by decreasing the speed of generator down to the stall region. For smooth control between MPPT and soft-stalling, the soft-stalling control is designed a PI controller [11]. This controller provides the compensation terms to subtract from rated speed value, ω_{rN} , to achieve stall operations. The overall block diagram of the MPPT and the soft-stalling controller is shown in Fig. 2.

3.3 Optimum point tracking of the d -axis rotor current

Usually, the d -axis rotor current of the RSC is regulated to keep the stator reactive power, Q_s , at zero. With this strategy, the grid side converter (GSC) does not have to compensate for the reactive

power of the machine. However, the d -axis rotor current corresponding to zero stator reactive power is high and, hence, causes additional copper losses in the rotor winding that is undesired [16]. An optimal tracking of the d -axis rotor current is provided in this paper to minimise copper losses of DFIG.

3.3.1 Model-based loss minimisation control: To achieve minimum copper losses, the optimal d -axis rotor current can be calculated via the DFIG model [15]. From (5) and (9), the steady-state copper losses of the DFIG are

$$P_{SS_cu} = \frac{3}{2} r_s (i_{sq}^2 + i_{sd}^2) + \frac{3}{2} r_r (i_{rq}^2 + i_{rd}^2) \quad (16)$$

Substituting (6) into (16) yields

$$\begin{aligned} P_{SS_cu} = & \frac{3}{2} \left(r_r + \frac{L_m^2}{L_s^2} r_s \right) i_{rq}^2 + \frac{3}{2} \frac{\psi_{sd}^2}{L_s^2} r_s \\ & - \frac{3\psi_{sd} L_m r_s}{L_s^2} i_{rd} + \frac{3}{2} \left(r_r + \frac{L_m^2}{L_s^2} r_s \right) i_{rd}^2 \end{aligned} \quad (17)$$

As it has been assumed ψ_{sd} constant, the power losses can be minimised by the following equation:

$$\frac{\partial P_{SS_cu}}{\partial i_{rd}} = -\frac{3L_m r_s \psi_{sd}}{L_s^2} + 3 \left(r_r + \frac{L_m^2}{L_s^2} r_s \right) i_{rd} = 0 \quad (18)$$

and, hence, the optimal i_{rd} to minimise copper losses is

$$i_{rd}^* = \frac{L_m r_s \psi_{sd}}{L_m^2 r_s + L_s^2 r_r} \quad (19)$$

3.3.2 PSO searching control: In the PSO algorithm, n candidate solutions are called particles, (x_1, x_2, \dots, x_n) . At each iteration, each particle x_i directs to the optimal solution under the domination of the best particle in a neighbourhood (x_{gbest}) and the best solution found for each particle so far ($x_{pbest,i}$). Each particle is updated using the following formula:

$$x_i(k+1) = x_i(k) + v_i(k+1) \quad (20)$$

where v_i is the velocity of each particle. The velocity is updated calculated as follows:

$$\begin{aligned} v_i(k+1) = & w v_i(k) + c_1 r_1 (x_{pbest,i} - x_i(k)) \\ & + c_2 r_2 (x_{gbest} - x_i(k)) \end{aligned} \quad (21)$$

where r_1 and r_2 are random vectors with values between 0 and 1, c_1 and c_2 are learning parameters used as acceleration coefficient and w is the inertia weigh [20].

For the optimum tracking of the d -axis rotor current with PSO, the candidate solutions are

$$x_i(k) = [i_{rd,1}^*, i_{rd,2}^*, \dots, i_{rd,n}^*] \quad (22)$$

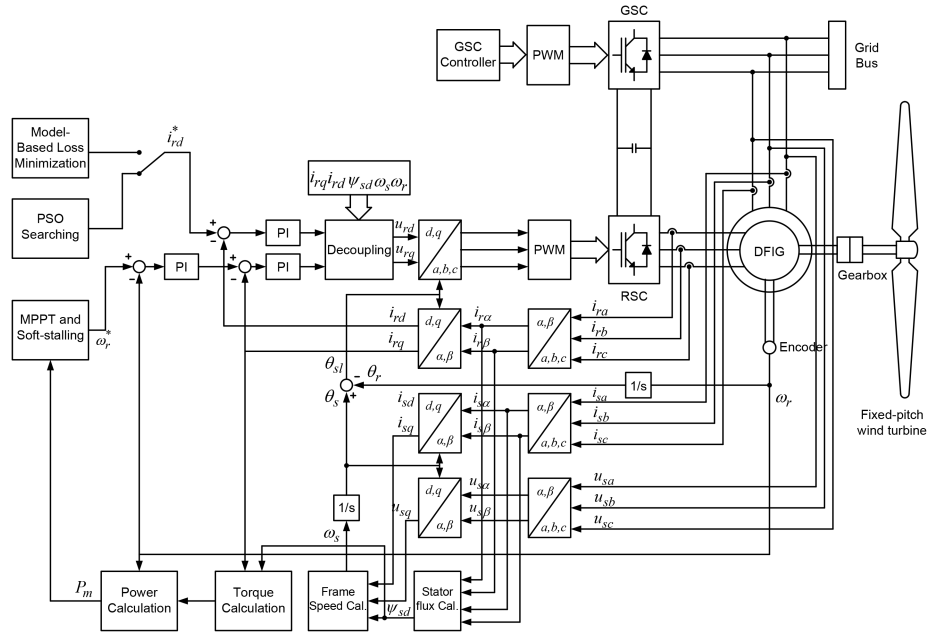


Fig. 3 Optimal control block diagram of the WECS based on DFIG

Table 1 Wind Turbine characteristics

Parameter	Value	Unit
rated power (P_{mN})	5	kW
blade radius (R)	2.327	m
gearbox ratio (G)	7	—
rated wind speed (V_{rated})	10	m/s
cut-in wind speed (V_{cut-in})	4	m/s
cut-out wind speed ($V_{cut-out}$)	14	m/s
maximum power coefficient (C_{pmax})	0.48	—
optimal TSR (λ_{opt})	8.1	—
moment of inertia referred to generator side (J_T)	0.5	kg m ²

Table 2 DFIG characteristics [13]

Parameter	Value	Unit
synchronous speed	1500	rpm
rated stator voltage	380	V
rated stator current	8.36	A
rated torque	31.8	Nm
rated rotor voltage	205	V
stator-rotor turns ratio	0.54	—
stator resistance (R_s)	720	mΩ
stator leakage inductance (L_{ls})	5.8	mH
mutual inductance (L_m)	85.8	mH
rotor resistance referred to stator phase (R_r)	750	mΩ
rotor leakage inductance referred to stator phase (L_{lr})	5.8	mH
number of pole pairs (p)	2	—
inertia (J_G)	0.024	kg m ²

Then, the optimal d -axis rotor current corresponds to maximum electrical power generated by the DFIG; hence, the objective function of PSO is evaluated as

$$P_c(i_{rd,i}^*(k)) > P_c(i_{rd,i}^*(k-1)) \quad (23)$$

4 Simulation results

The block diagram of the optimal control of the WECS is shown in Fig. 3. The wind turbine is coupled with the DFIG via a gearbox and the DFIG is connected to the busbars of a stiff grid. A back-to-back converter supplies the rotor circuit: the RSC controls the generator speed and the stator reactive power, while the GSC controls the grid reactive power and the DC-link capacitor voltage. The MPPT is used for tracking the maximum mechanical power from the wind, while the reference for the shaft speed is given by the optimisation algorithm. Copper losses of the DFIG are minimised through the control of the d -axis rotor current. The parameters of the DFIG and the wind turbine used for the simulations are given in Tables 1 and 2, respectively.

The proposed optimal control algorithm is verified using Matlab/Simulink to validate its performances incorporating a DFIG model, wind turbine model and vector control. The MPPT and soft-stall controller are applied as per Fig. 2 and the pitch angle of the turbine is fixed at zero. To improve the efficiency of DFIG, the MBLC and PSO algorithm are used to compare the performance of results when DFIG parameter values are changed from the parameters given in Table 2. The optimal d -axis rotor current reference of the MBLC is provided by (19). The PSO search is done by its algorithm aforementioned above with three d -axis rotor current reference candidates. The parameters of PSO are defined as

r_1, r_2 are 0.5, c_1, c_2 are 0.729, 1.494 and w is 0.15, respectively. The sampling period of PSO is chosen as 0.3 s.

Figs. 4 and 5 show the performance of the proposed control system when the wind speed changes as a step every 40 s and the mutual inductance of DFIG is uncertain and the control uses a value smaller than 50% of the real one in Table 2. The simulations show that the MPPT control based on PSF and soft-stalling has adequate performance in the entire speed range as shown in Figs. 4a and 5a. The speed variation is limited by the inertia of the wind turbine and the generator and, as such the performance would be affected when the wind speed has a high rate of variation. The simulations in Figs. 4b and 5b also compare PSO and MBLC in terms of electrical power and energy. The figures show that the energy generated by PSO is slightly higher than that of MBLC in both cases. Also, it can be observed that the proposed control gives smooth generator speed trajectory between the MPPT and soft-stalling controller for both step-up and step-down change of wind speed, i.e. at 80 s in Fig. 4 and 40 s in Fig. 5.

The influence on the error in the estimation of DFIG parameters has been analysed in Table 3 for a constant wind speed of 8 m/s concerning L_m and R_r , which are the parameters most likely to be affected by the operating conditions of the machines. Table 3 shows that the error on the estimation of L_m produces a much larger effect than the error on R_r . For example, in case of an error of -50% in the estimation of L_m , the PSO generates 1.78% more energy than MBLC over 2 min, i.e. 1 kWh/day extra.

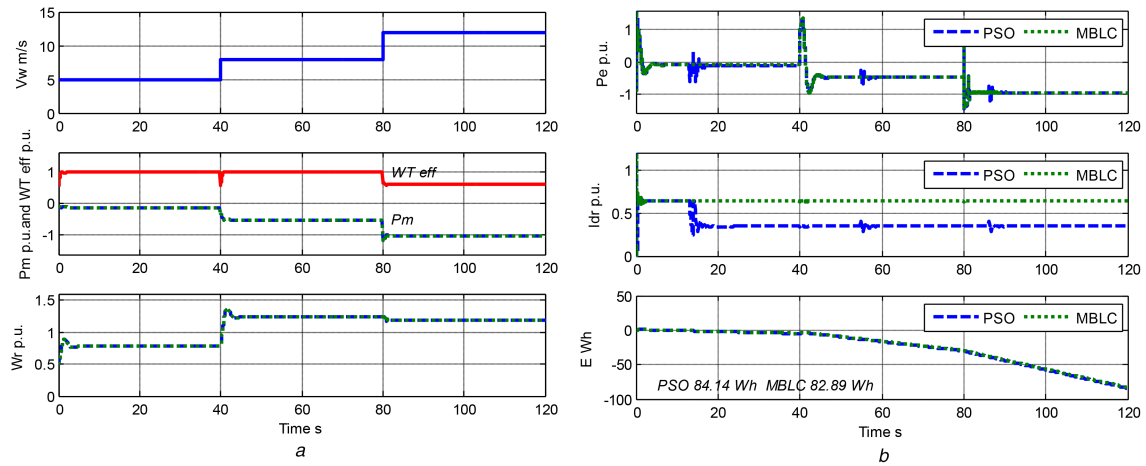


Fig. 4 Simulation results of proposed control with step changing wind speed from 5 to 8 and then from 8 to 12 m/s when the error on the estimation of L_m is -50%

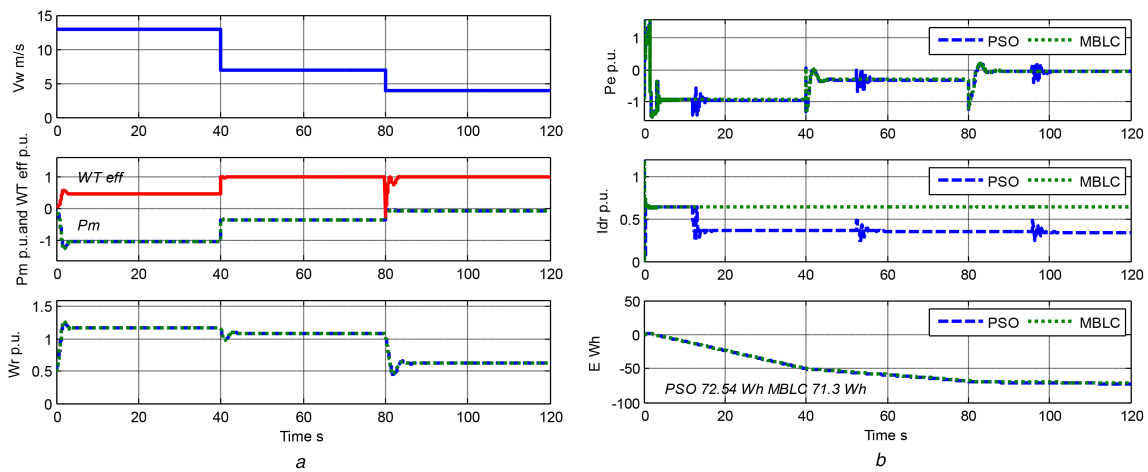


Fig. 5 Simulation results of the proposed control with step-changing wind speed from 13 to 7 and from 7 to 4 m/s when the error on the estimation of L_m is -50%

Table 3 Energy generated by the DFIG with a PSO in comparison with an MBLC with an error in the estimation of machine parameters for simulation of 2 min

DFIG parameter variations of model-based method	Extra energy extracted from PSO
variation of -10% of L_m	-0.01%
variation of -30% of L_m	$+0.33\%$
variation of -50% of L_m	$+1.78\%$
variation of $+10\%$ of R_r	-0.01%
variation of $+30\%$ of R_r	$+0.04\%$
variation of $+50\%$ of R_r	$+0.10\%$

5 Conclusion

This paper proposes a new optimal control of WECS with DFIG for fixed-pitch wind turbines to maximise the mechanical and electrical powers. The simulations on a sample wind turbine with DFIG show that MPPT based on PSF and soft-stalling and PSO controllers give improved efficiencies for the entire speed range of the turbine. The proposed control also provides smooth generator speed trajectory at the transition from PSF to soft-stalling.

The PSO searching control algorithm provides advantages of robustness of the control against uncertainties on the parameters of the DFIG. The simulations have shown that the rotor speed has to change substantially to follow the variations of the wind speed, but this is limited by the wind turbine inertia. This issue requires further work on the analysis of the control strategy for extremely variable wind speeds, where the torque of the generator could be reversed to improve the dynamical response of the speed control.

6 Acknowledgments

The authors thank the Thai government for sponsoring the PhD Scholarship of the lead author.

7 References

- [1] Hau, E.: 'Wind turbines fundamentals, technologies, application, economics' (Springer, Berlin, Germany, 2006)
- [2] Chen, Z., Guerrero, J.M., Blaabjerg, F., et al.: 'A review of the state of the art of power electronics for wind turbines', *IEEE Trans. Power Electron.*, 2009, **24**, (8), pp. 1859–1875
- [3] Pena, R., Clare, J.C., Asher, G.M.: 'Doubly fed induction generator using back-to-back PWM converters and its application to variable-speed wind-energy generation', *IEE Proc. – Electr. Power Appl.*, 1996, **143**, (3), pp. 231–241
- [4] Miller, A., Muljadi, E., Zinger, D.S.: 'A variable speed wind turbine power control', *IEEE Trans. Energy Convers.*, 1997, **12**, (2), pp. 181–186
- [5] Kumar, D., Chatterjee, K.: 'A review of conventional and advanced MPPT algorithms of wind energy systems', *Sci. Direct, Renew. Sustain. Energy Rev.*, 2016, **55**, pp. 957–970

- [6] Cai, S., Wen, H.: 'Modeling and MPPT control of DFIG wind energy system'. *Renew. Power Gener.* 2015, Beijing, China, 2015
- [7] Thongam, J.S., Bouchard, P., Beguenane, R., *et al.*: 'Control of variable speed wind energy conversion system using a wind speed sensorless optimum speed MPPT control method'. *IECON 2011 – 37th Annual Conf. IEEE Industrial Electronics Society*, Melbourne, Australia, 2011, pp. 855–860
- [8] Du, X., Yin, H.: 'MPPT control strategy of DFIG-based wind turbines using double steps hill climb searching algorithm'. *Proc. 5th Int. Conf. on Electric Utility Deregulation, Restruct. Power Technol. DRPT*, 2015, Changsha, China, 2016
- [9] Neammanee, B., Sirisumrannukul, S., Chatratana, S.: 'Control strategies for variable-speed fixed-pitch wind turbines', *Wind Power Tech*, 2010
- [10] Vihriala, H.: 'Control of variable speed wind turbine'. PhD Thesis, Tampere University of Technology, 2002, pp. 209–232
- [11] Jiawei, C., Changyun, W., Yongduan, S.: 'Power control strategy for variable-speed fixed-pitch wind turbines'. *2014 13th Int. Conf. on Control, Automation, Robotics and Vision, ICARCV 2014*, Singapore, 2014, pp. 559–564
- [12] Xin-fang, Z., Da-ping, X., Yi-bing, L.: 'Adaptive optimal fuzzy control for variable speed fixed pitch wind turbines'. *5th World Congress on Intelligent Control and Automation (IEEE Cat. No.04EX788)*, Hangzhou, China, vol. 3, 2004, pp. 2481–2485
- [13] Mesemanolis, A., Mademlis, C., Kioskeridis, I.: 'Optimal efficiency control strategy in wind energy conversion system with induction generator', *IEEE J. Emerg. Sel. Top. Power Electron.*, 2013, 1, pp. 238–246
- [14] Abed, G., Lopez, J., Rodriguez, M.A., *et al.*: '*Doubly fed induction machine modeling and control for wind energy generation*' (John Wiley & Sons, Inc., 2011)
- [15] Krajangpan, K., Sadara, W., Neammanee, B.: 'Control strategies for maximum active power and minimum copper loss of doubly fed induction generator in wind turbine system'. *2010 Int. Conf. Power Syst. Technol. Technol. Innov. Mak. Power Grid Smarter*, Hangzhou, China, 2010, pp. 1–7
- [16] Kasem, A.H., El-Saadany, E.F., El-Tamaly, H.H., *et al.*: 'Performance enhancement of DFIG-based wind turbines close to the rated operation'. *40th North Am. Power Symp. NAPS2008*, Calgary, Canada, 2008, pp. 6–11
- [17] Zhang, B., Hu, W., Chen, Z.: 'Loss minimizing operation of doubly fed induction generator based wind generation systems considering reactive power provision'. *IEEE Industrial Electronics Society IECON 2014*, Dallas, TX, USA, 2014
- [18] Toliyat, H., Levi, E., Raina, M.: 'A review of rfo induction motor parameter estimation techniques', *IEEE Trans. Energy Convers.*, 2003, 18, (2), pp. 271–283
- [19] Kennedy, J., Eberhart, R.: 'Particle swarm optimization'. *1995 Proc. IEEE Int. Conf. Neural Networks*, Perth, Australia, vol. 4, 1995, pp. 1942–1948
- [20] Ishaque, K., Salam, Z., Amjad, M., *et al.*: 'An improved particle swarm optimization (PSO)-based MPPT for PV with reduced steady-state oscillation', *IEEE Trans. Power Electron.*, 2012, 27, (8), pp. 3627–3638